



SECTION A-A

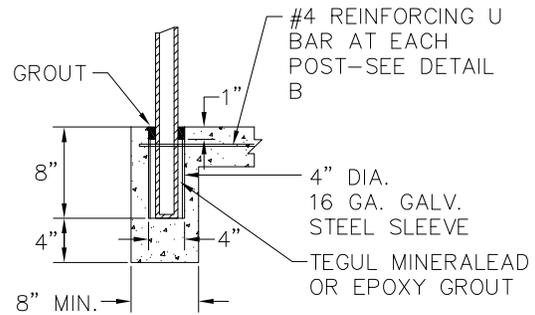

DETAIL A

NOTES:

1. RAILING SHALL BE HOT DIP GALVANIZED AFTER FABRICATION.
2. ALL POSTS SHALL BE PLUMB AND RAILS PARALLEL TO GRADE.
3. PIPE MATERIAL SHALL CONFORM TO ASTM A53.
4. REINFORCING STEEL ASTM A615, GRADE 60.



DETAIL B

NOT TO SCALE

STEEL PIPE HANDRAIL  
FOR SIDEWALK

ADOPTED  
CITY OF RENTON

STANDARD PLANS  
LST DATE: 04/04



DATE	REVISION	BY	APPR'D